



LBU403B140L in operation without any problem since 2003



Air entrainment „above max. liquid level“

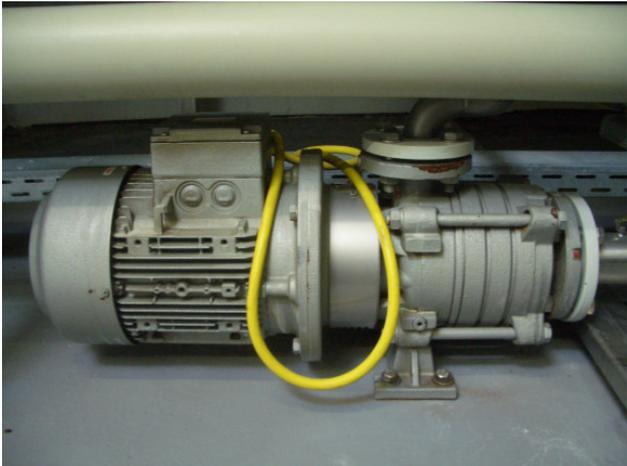

Air entrainment into suction pipe in front of inlet flange of DAF-pump

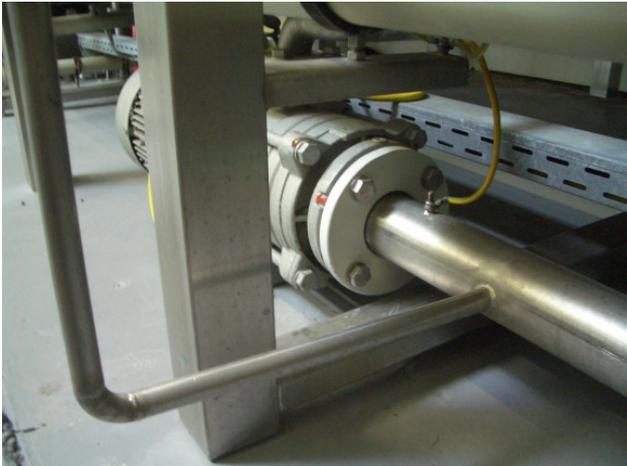

Pipe line recycle flow with pre-cleaned water



Inflow of pre-cleaned water out of recycle flow towards the pump



Pressure pipe from DAF-pump towards sedation pipe



Climb to flotation tank



View into flotation tank (flotate, skimmer)



Tanks for chemicals (iron-II-chloride, iron-III-chloride, aluminium-sulphate)



Dosing system (Prominent)



Flocculant tank

